

Old XPSAT substituted by new XPSATE


How to substitute old XPSAT unit
with time-delayed outputs by the
new equivalent XPSATE

Old XPSAT unit substituted by new XPSATE

- Main differences



XPSAT



XPSATE


Safety Function Monitoring										Output contacts nb										
Unit model	Category										Safe		Unsafe	Enclosure	Electr.	Connec.	Approvals			
											Time			width	Fixed	Pull	UL			
											delay			mm			CSA/C-UL	BG/Tüv		
XPSATE	●	●	●	2	3	4	DC	24V AC	120V AC	230V AC	NO	2	3		4	45	●	●	●	●
XPSAT	●	●	●	2	3	4	DC	24V AC	120V AC	230V AC	NO	3	2	1		90	●	●	●	●

Old XPSAT unit substituted by new XPSATE


- **Easy substitution**

- All connection terminals are at the same side in the front face
- Terminals and wiring diagram are the same in the substitution for the inputs and the existing outputs

Repérage des bornes / Terminal marking

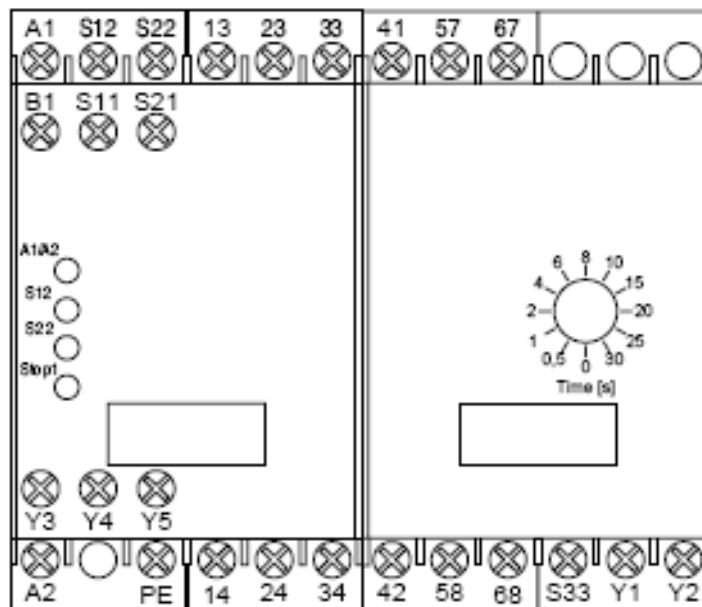

XPS-AT...

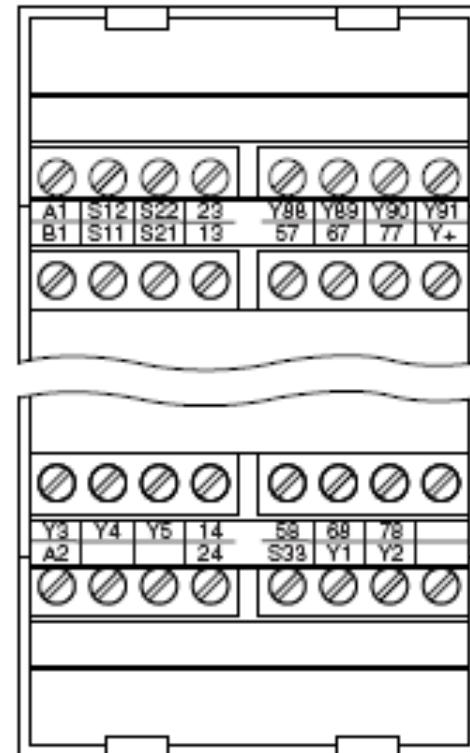

XPS-ATE....

Old XPSAT unit substituted by new XPSATE

- Cross-reference table

Supply Voltage	Old Reference	New Reference *
24VAC/DC	XPS-AT5110	XPS-ATE5110
120VAC	XPS-AT3410	XPS-ATE3410
230VAC	XPS-AT3710	XPS-ATE3710
*add P to reference for removable plug terminals		

- How to replace

